

Analysis of Solar Potential in Brisbane for the Climate Media Centre

Summary

There is significant potential for rooftop solar PV in Australia. Rooftop solar PV is a key energy technology because it is leading the transition to consumer uptake of low-carbon demand-side energy technologies, which are providing new opportunities for consumer engagement and new clean energy business models to emerge. However, there is a lack of good information in the public domain about the potential for rooftop solar to contribute to low-carbon electricity generation in Australia's cities. This type of information is important for policymakers and planners, and to encourage public support for rooftop solar.

The Climate Media Centre commissioned this research, which uses the data and methodologies behind the APVI Solar Potential Tool <http://pv-map.apvi.org.au/potential>, developed by researchers at UNSW, to estimate the Solar Potential in the Brisbane CBD. The report includes:

1. An assessment of PV Potential in Brisbane CBD
2. An estimate of the potential impact of rooftop PV on local electricity consumption and emissions
3. Identification of rooftops with the largest PV potential (area available) in the CBD
4. Three case studies of PV Potential on landmark buildings in Brisbane

The useable area suitable for PV deployment across Brisbane's CBD was calculated using two different methods. **The most conservative estimate of the two suggests the useable area suitable for rooftop PV deployment (the ratio between the area of PV panels that could be accommodated and the total roof area) is 36% corresponding to 151 MW of PV potential with an expected annual yield of 197 GWh. The equivalent CO₂ emission savings are 145 kt per year.**

The average of the two methods indicated that an area equal to 45% of the available roof surfaces could be used to accommodate PV, corresponding to 188 MW of potential PV capacity with an expected annual yield of 241 GWh. This equates to 11% of the 2,190 GWh of load seen by all of the zone substations within or near the CBD area (2,190 GWh may be an overestimate of the CBD load, since these substations also serve loads outside of the CBD area). The potential CO₂-equivalent emission savings from PV based on the average of the two PV potential estimation methods are 177 kt per year. There is an estimated 1.1 MW of existing PV capacity installed on Brisbane CBD rooftops, less than 1% of the potential capacity. Almost all of the electricity generation and emissions savings calculated would therefore be additional.

The breakdown across different building types is shown in Table 1 below.

Table 1: Summary of results categorised by the Brisbane City Plan 2014 zoning layer

Brisbane City Council Zoning	PV Capacity (MW)	PV Yield (GWh)
	Average	Average
All	187.86	241.06
Centre	52.29	64.89
Community facilities	3.65	4.64
Emerging communities	3.24	4.22
General residential	42.32	54.98
Mixed use	62.25	80.94
Planning scheme	18.37	23.92
Recreation and open space	0.79	1.00
Special purpose	0.18	0.21
Specialised centre	3.77	4.90
Sport and recreation	0.63	0.84

The rooftops with the largest PV potential in Brisbane have been mapped (Figure 1 below). More detailed images appear in Appendix C.

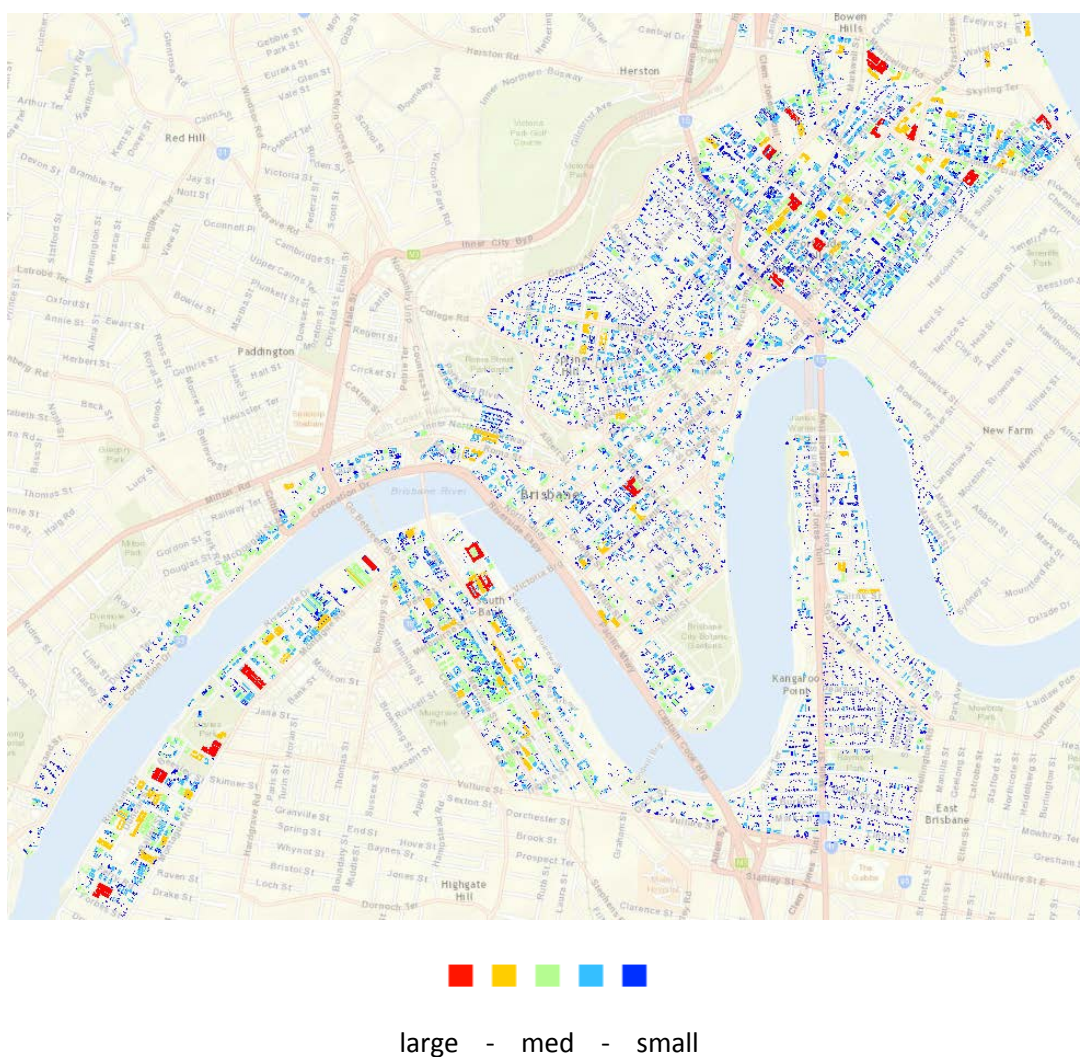


Figure 1: Rooftops with Largest PV Potential in Brisbane CBD

Case studies of specific landmark buildings include Queensland Performing Arts Centre (QPAC), the Suncorp Stadium and Roma Street Station have been conducted.

Table 2 shows the potential roof area available for PV installation on each building, based on the data and visual imagery available. Despite their irregular roof profiles, both QPAC and Roma Street Station show potential for utilisation of just under half of the total roof area, comparing favourably with the average across the CBD. The simple roof profile and lack of shading give the Suncorp Stadium very high potential utilisation.

Table 2: Available roof areas on the Case Study Buildings

Site	Building Footprint (m ²)	Total Roof Area (m ²)	Developable Planes (m ²)	Array Area (m ²)	Array Area / Roof Area
Suncorp Stadium	41,426	24,200	not available	21,302	88%
Roma St Station	14,359	11,503	6,357	5,525	48%
QPAC	11,791	11,791	8,543	5,760	49%

Table 3 shows the projected array capacity and expected annual energy production. The proposed PV arrays are illustrated in Figure 22 -Figure 24 below.

Table 3: Expected Annual Energy Production

Site	Array Power (kW)	Annual Energy Production (w/o shading) (MWh/year)	Average Yield across developable planes (kWh/kW/day)	Expected Annual Energy Production (MWh/year)
Suncorp	3328.5	4684	3.84	4670
Roma St	863.3	1196	3.61	1136
QPAC	900.0	1300	3.57	1172

Table 4 presents the estimated carbon offsets for each system and shows that these three buildings could save an estimated 5.2 kilotonnes of carbon emissions each year and could supply the equivalent of 1200 households, based on the average 2014 electricity demand of a Queensland household being 5793 kWh [8].

Table 4: Carbon offset and household energy equivalents

Site	Expected Annual Energy Production (MWh/year)	Emissions Offset (Tonnes CO ₂ -e / year)	Average household equivalent
Suncorp	4670	3493	806
Roma St	1136	847	196
QPAC	1172	874	202
Totals	6978	5214	1205

Array Illustrations



Figure 2: Potential PV Array on Suncorp Stadium



Figure 3: Potential PV Array on QPAC

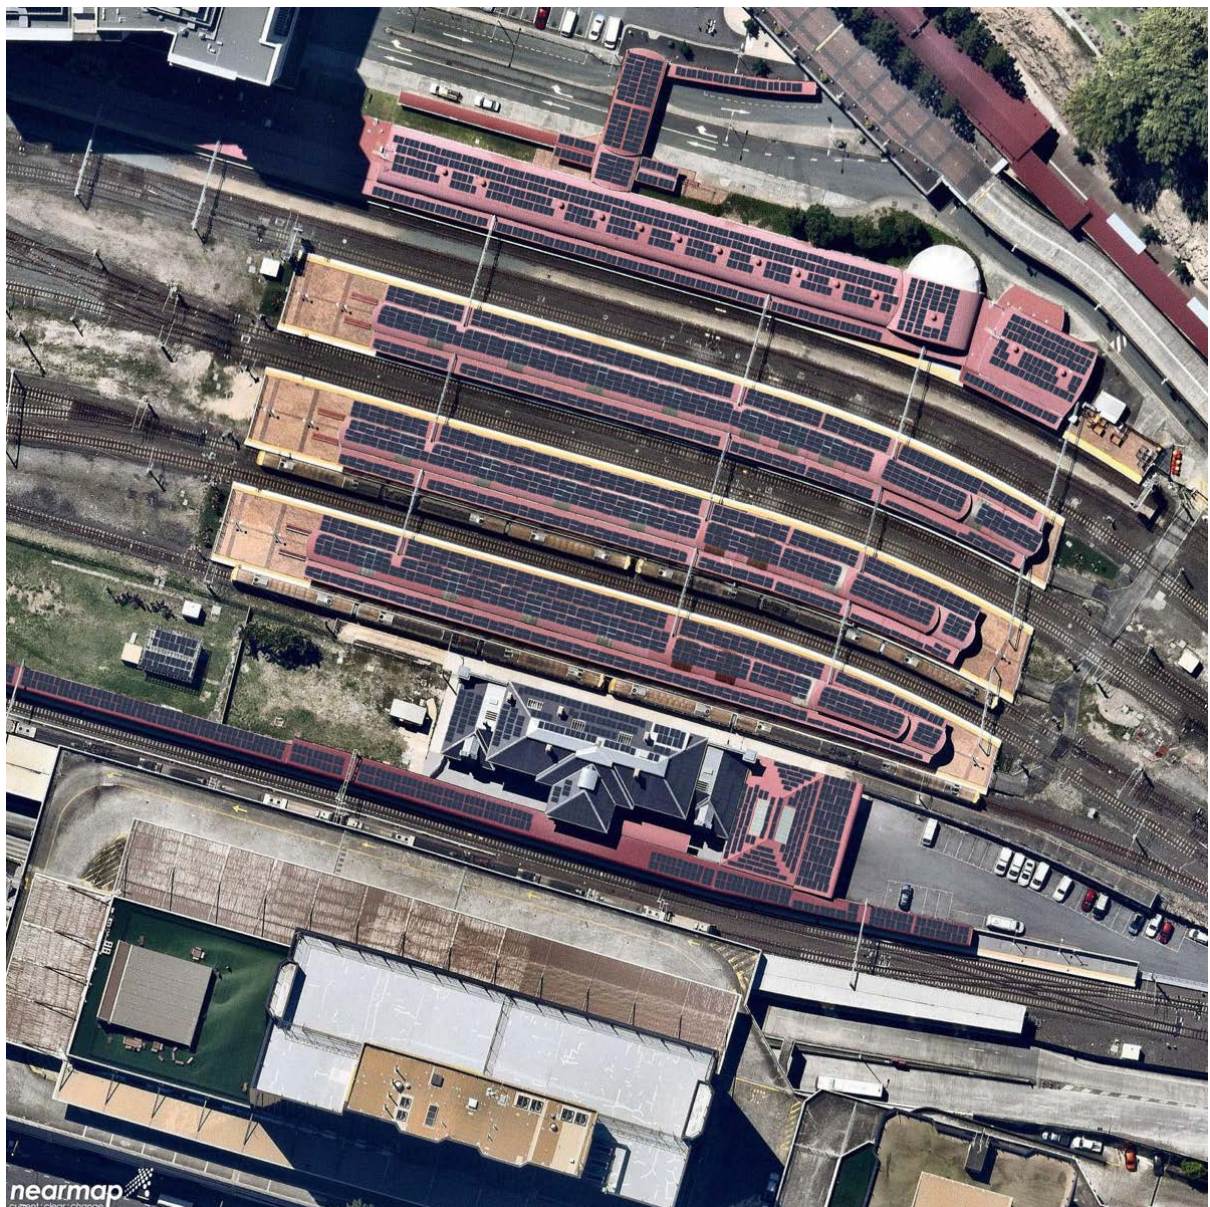


Figure 4: Potential PV Array at Roma Street Station

Introduction to the Solar Potential Tool

The APVI Solar Potential Tool (SPT) is an online tool to allow electricity consumers, solar businesses, planners and policymakers to estimate the potential for electricity generation from PV on building roofs. The tool accounts for solar radiation and weather at the site; PV system area, tilt, orientation; and shading from nearby buildings and vegetation.

The data behind the APVI SPT were generated as follows:

1. Three types of digital surfaces models (DSMs)¹ (3D building models, XYZ vegetation points and 1m ESRI Grids), supplied by geospatial company [AAM](#), were used to model the buildings and vegetation in the areas covered by the map.
2. These DSMs were used as input to [ESRI's ArcGIS](#) tool to evaluate surface tilt, orientation and the annual and monthly levels of solar insolation falling on each 1m² unit of surface.
3. Insolation values output by the ArcGIS model were calibrated² to [Typical Meteorological Year](#) (TMY) weather files for each of the capital cities and against estimates of insolation at every 1 degree tilt and orientation from [NREL's System Advisor Model \(SAM\)](#).

At a city level, an insolation heatmap layer (Figure 5b) allows identification of the best roofs, while the shadow layer (Figure 5c) allows the user to locate an unshaded area on a rooftop. On a specific roof surface, an estimate of annual electricity generation, financial savings and emissions offset from installing solar PV can be obtained.

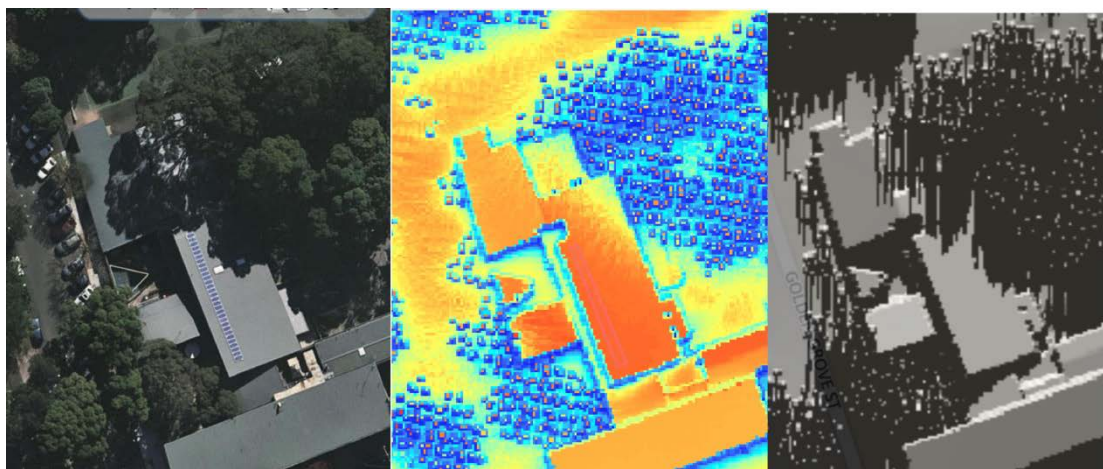


Figure 5: (a) Aerial photograph (b) Insolation heat map, (c) Winter shadow layer

This project expanded the data and methodologies behind the Solar Potential in order to estimate the Solar Potential in the Brisbane CBD region.

¹ Digital surface models provide information about the earth's surface and the height of objects. 3D building models and vegetation surface models have been used in this work. The ESRI Grid is a GIS raster file format developed by ESRI, used to define geographic grid space.

² Calibration was required in order to obtain good agreement NREL's well-tested SAM model and measured PV data.

Assessment of the PV Potential in Brisbane CBD

This section of the report details the methodology and the results of the geospatial analysis of PV potential across Brisbane CBD.

Methodology

The assessment of the PV potential in Brisbane's CBD, expanded on the initial work undertaken for the Brisbane region of APVI's SPT. The analysis made use of the following data sources:

1. The three sources of input DSMs data from AAM,
2. Queensland's LiDAR data Brisbane City Council (LGA) – 2009 dataset sourced from Geoscience Australia; and
3. [Brisbane City Council's Brisbane City Plan 2014 Zoning](#) layer

The general steps in the methodology are illustrated in Figure 6. To test the sensitivity of the estimated PV potential two input data sources and two rooftop suitability methods were assessed. The two input data sources used to calculate the tilt, aspect, solar insolation and determine suitable roof planes were 1) the DSM and 3D building models from AAM and 2) the 2009 Queensland LiDAR data for Brisbane City Council. The two methods utilised to determine suitable rooftops were 1) based on a minimal level of surface insolation and 2) NREL's PV rooftop suitability method based on hillshade and surface orientation. Both methods also required a minimum contiguous surface area of 10m² for a roof plane to be determined suitable. This limit was defined to ensure a minimum 1.5kW PV system for any plane defined as suitable.

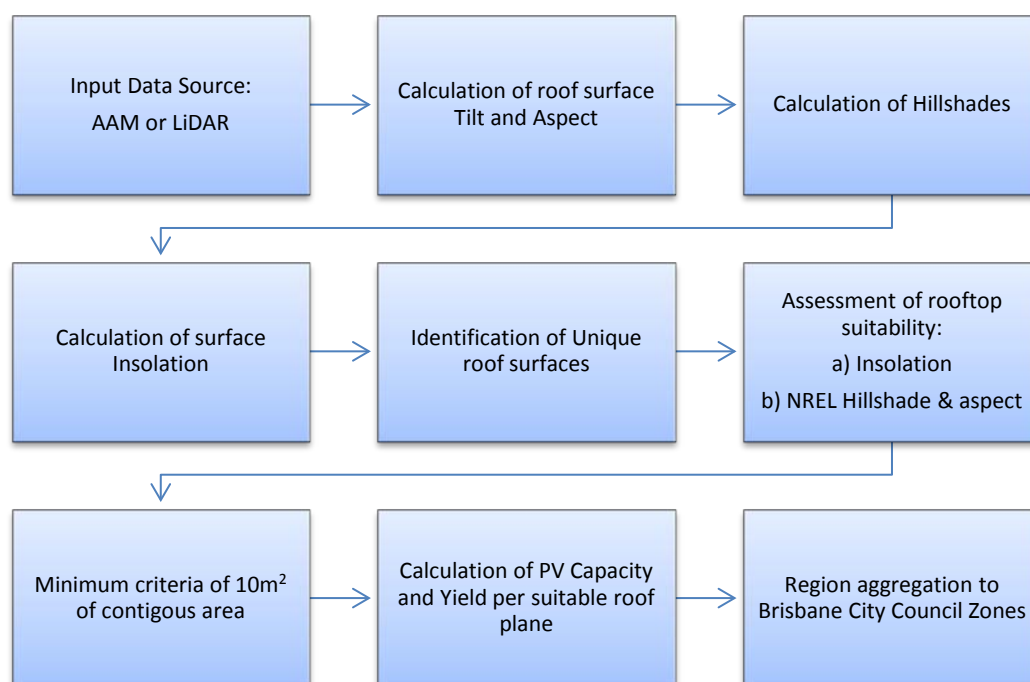


Figure 6: Major process steps for the calculation of rooftop PV potential

The regions covered by the analysis and the relevant planning zones used to classify the PV potential opportunity are shown in Figure 7.

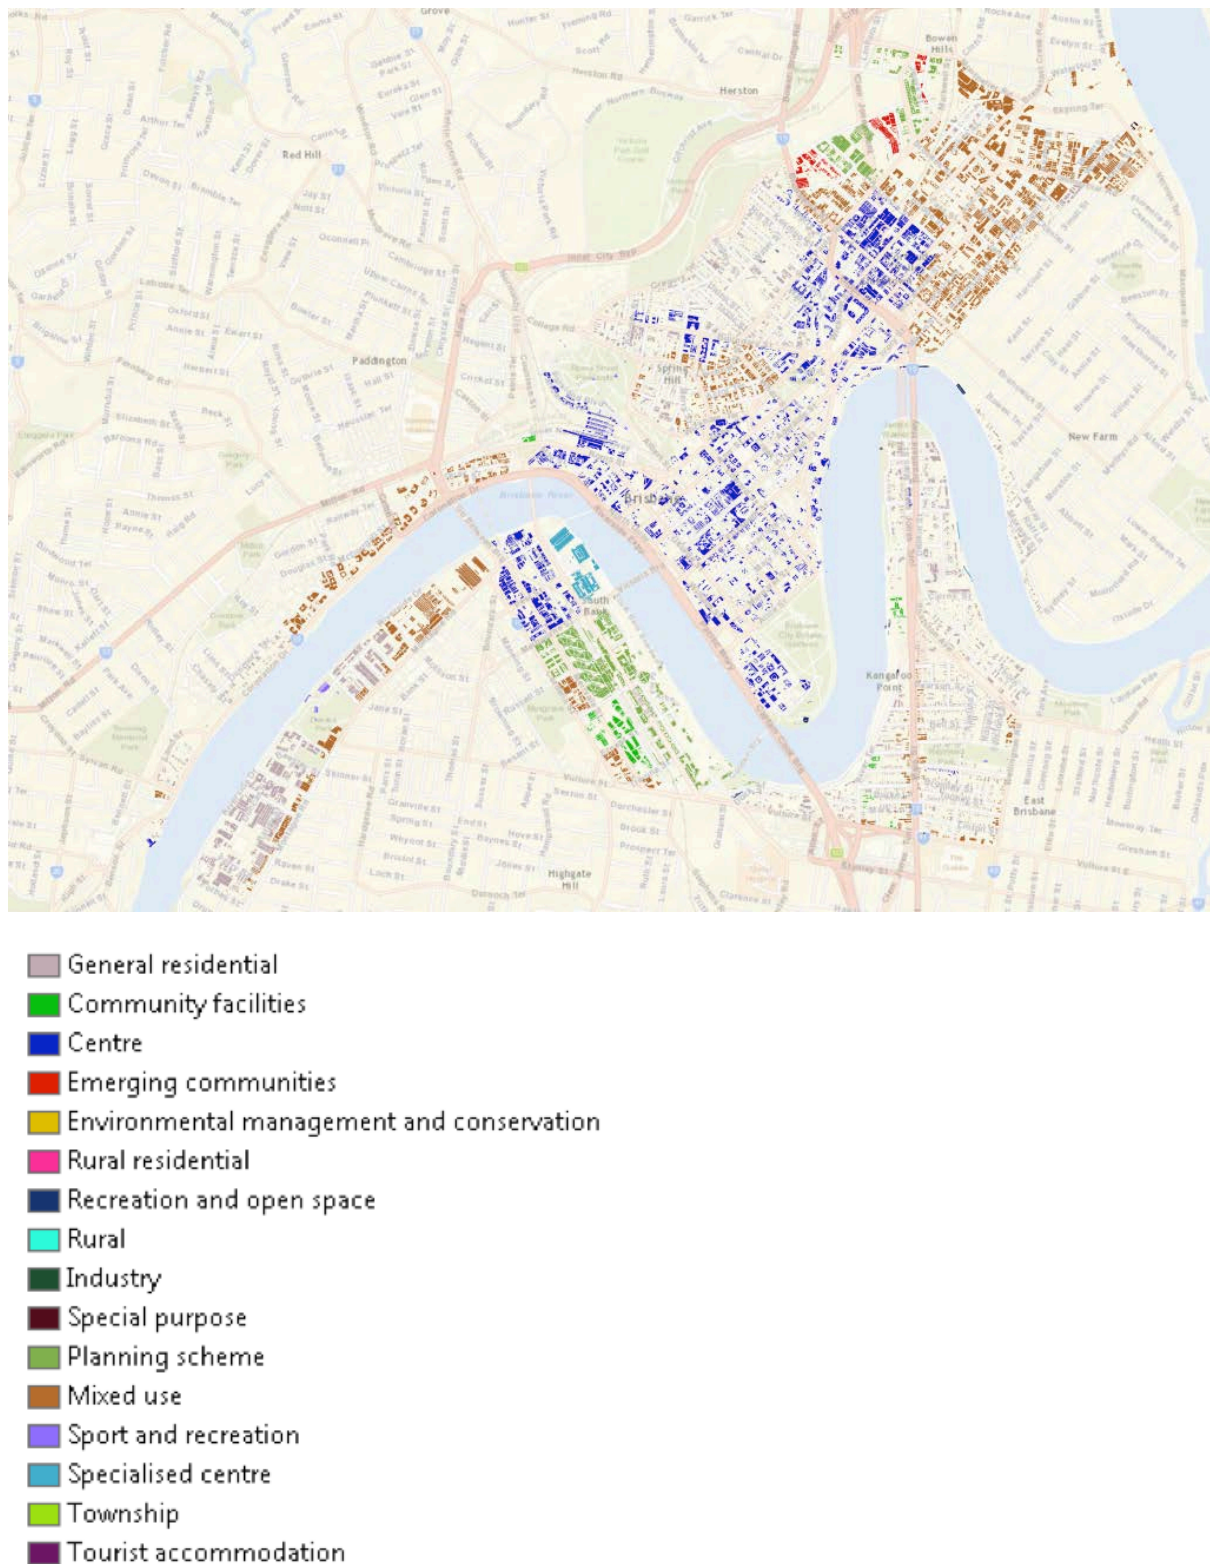


Figure 7: Brisbane CBD Planning Zones

Method 1: Insolation Limit

The first method utilised to determine suitable roof planes was based on a minimum level of insolation. The minimum value was set at an annual average insolation of **4 kWh/m²/day**. This limit was calculated as 80% of the expected level of annual insolation for a horizontal surface in Brisbane, calculated as 5.03 kWh/m²/day, using the default TMY weather file for Brisbane contained within the National Renewable Energy Laboratories (NREL) System Advisor Model (SAM). This limit was applied to the Solar Insolation Heat Map which was developed and calibrated as part of the APVI SPT methodology [1, 2].

Figure 9 presents an example application of the insolation limit in practice, displaying an aerial image (left), the insolation heat map (centre) and the classified insolation layer (right); classified as either above (white) or below (black) the insolation limit. As for each method in this report, a 10m² contiguous area was required for a roof plane to be determined suitable. Figure 10 presents the roof planes that were identified to meet both the insolation and 10m² contiguous area criteria for the example presented in Figure 9.

Figure 8 - Minimum distance from rooftop obstruction for 80% annual output

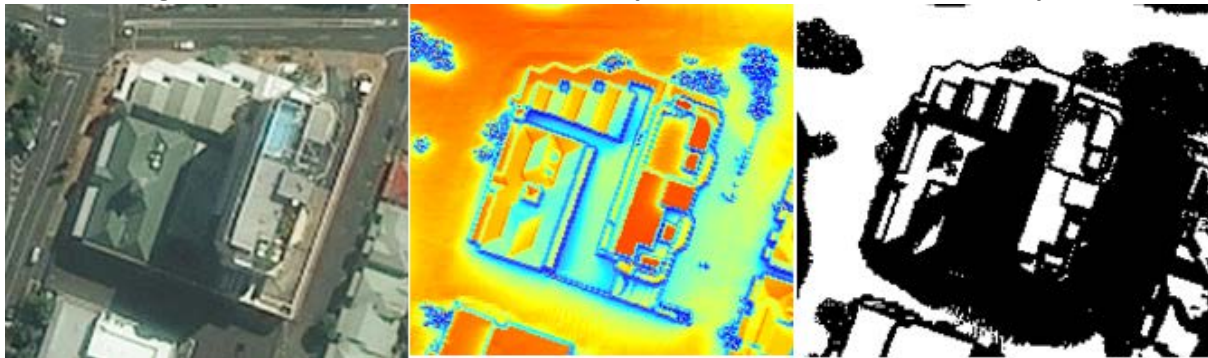


Figure 9: Example application of the Insolation limit. Areal image (left); Insolation heat map (centre); and classified Insolation layer (right)

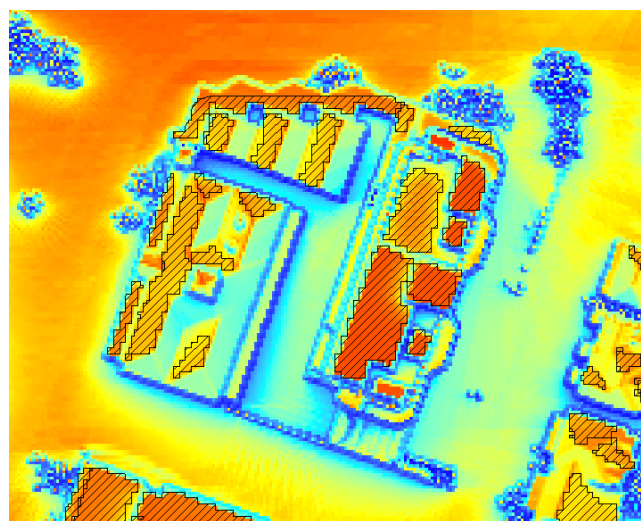


Figure 10: Example application of suitable planes (hatched areas) by the Insolation limit method.

Method 2: NREL's Hillshade and Orientation

The second method utilised to determine suitable roof planes was the method developed by NREL to assess the technical potential for rooftop PV in the United States [3]. NREL's method makes use of ArcGIS's hillshade function to determine the number of hours of sunlight received on each 1m^2 of roof surface, across 4 representative days within a year i.e. the winter and summer solstices and the two equinoxes; similar to the shadow layers of APVI's SPT as illustrated in Figure 5.

To determine which areas met the shading criteria, NREL's method defines that roof surfaces must meet a minimum number of hours of sunlight. The limit for any location can be determined by calculating the number of hours a rooftop would need to be in sunlight to produce 80% of the energy produced by an unshaded system of the same orientation [3]. For the location of Brisbane the value was determined to be **19.13 hours** across the 4 representative days, i.e. a minimum of 4.8 hrs/day of sunlight across the year.

In addition to the hillshade limit, NREL's method also excludes roof planes based on orientation. In NREL's method all roof planes facing northwest through northeast (i.e. $292.5 - 67.5$ degrees for northern hemisphere locations) were considered unsuitable for PV. For southern hemisphere locations the equivalent exclusion would be orientations southeast through southwest (i.e. $112.5 - 247.5$ degrees) as per Figure 11. Again as for each method in this report, a 10m^2 contiguous area is also required by NREL's methodology.

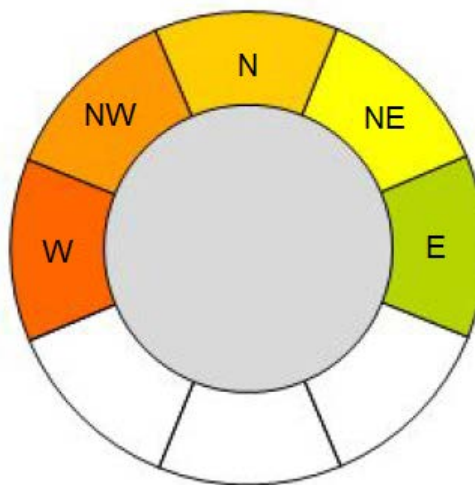


Figure 11: Rooftop azimuths included in final suitable planes for the Southern Hemisphere

Figure 12 presents an example application of NREL's hillshade and orientation limit in practice. For this particular example there is reasonable agreement between the surfaces determined as suitable for PV deployment from the two methods i.e. Figure 10 vs Figure 12. This is not always the case as evident in the example presented in Figure 13, which illustrates how the insolation limit method can define roof planes orientated southeast through southwest as suitable planes if the annual insolation meets the limit requirement.



Figure 12: Example application of the hillshade limit (left) with the suitable planes overlaid (right)



Figure 13: Comparison between roof planes defined as suitable by the insolation method (both - yellow) and NREL's hillshade and orientation method (Left – orange)

Input Data Source: AAM 3D Building Model vs. LiDAR data

The other variable that affected the sensitivity of the estimated PV potential was the input data source. Two input data sources were available for use in this analysis:

1. The DSMs and 3D building models from AAM, which were utilised to generate the APVI SPT,
2. The Queensland Brisbane City Council 2009 LiDAR dataset from Geoscience Australia.

The application of the PV potential analysis was applied identically to both input data sources.

Generally, Figure 14 demonstrates that there is general agreement between the roof planes identified as suitable via the two input data sources. However the figure also illustrates how the analyses undertaken with the LiDAR data set excludes a greater proportion of roof surfaces.



Figure 14: Example of good agreement between the two input data source for large buildings. Aerial image (Left), AAM 3D buildings with NREL method (centre); Queensland LiDAR with NREL method (Right)

Calculation of PV Capacity, Annual Yield and CO₂-e Emission Reductions

After suitable roof planes have been identified, the PV capacity and annual yield for each roof surface can be calculated. The DC PV capacity (otherwise known as system size) was calculated as per APVI's SPT methodology [1] using the DC size factor and array spacing methodologies [4]. The relevant equations for this method can be found [here](#).

Generally, the method assumes a fixed DC size factor of **156.25 W/m²** (i.e. a 250W module with dimensions of 1m x 1.6m) for flush mounted arrays, and a variable DC size factor for rack mounted PV arrays. For rack mounted arrays, the DC size factor is a function of the PV array tilt and orientation and the tilt and orientation of the underlying roof surface. Figure 15 presents the equivalent useable roof area, which is analogous to the DC size factor, for a 15 degree tilted north facing PV array in Brisbane, as a function of the tilt and orientation of the underlying roof surface. For an absolutely flat roof, Figure 15 indicates a useable area of 75%, analogous to a DC size factor of 118 W/m². In comparison, NREL's method assumes a fixed ratio of module to roof area of 70%³ for flat roof surfaces.

As per NREL's method to calculate the PV potential in the United States [3], this analysis has assumed that rack mounted arrays will be installed on flat and relatively flat roof surfaces. For consistency with NREL's method, **flat roofs have been defined as roof surfaces with a tilt ≤ 9.5 degrees** and the **tilt angle of the rack mounted arrays were defined as 15 degrees**.

Similarly, for tilted roof surfaces > 9.5 degrees, **an additional module to roof area ratio of 0.98** was assumed in the NREL method to reflect 1.27cm of spacing between each module for racking clamps. This assumption was also applied in this study.

³ An analysis of the average calculated useable area for the variable DC size factor method across the Brisbane CBD resulted in an average useable area of 70% across the roof surfaces defined as flat.

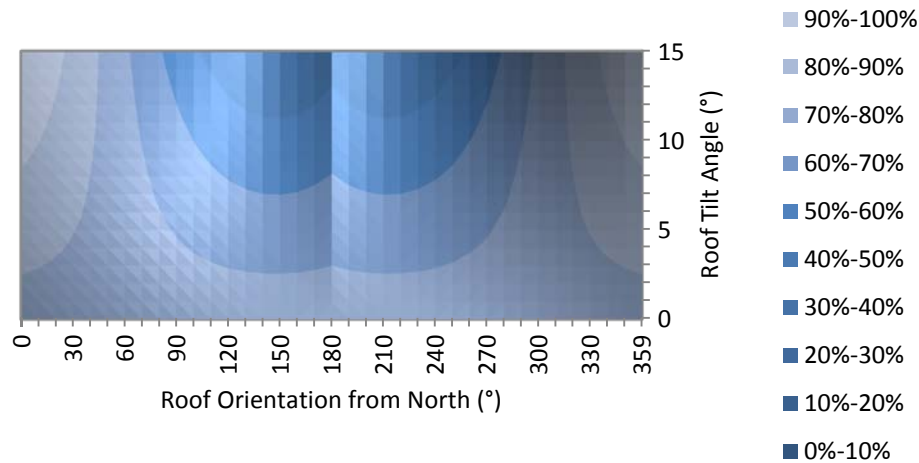


Figure 15: Percentage of useable roof area as a function of roof tilt and orientation for a 15 degree North facing array in Brisbane

The PV yield was calculated using APVI's SPT methodology as detailed [here](#). This method multiplies the calculated DC PV capacity by the average annual level of insolation calculated on the roof surface and by a **derating factor of 0.77**. The derating factor accounts for all the typical PV losses of temperature, soiling, wiring, mismatch, manufacturing module tolerance and inverter efficiency. This simplified method shows good agreement with detailed hourly PV performance simulations undertaken in NREL's SAM as illustrated in Appendix A.

The potential contribution of rooftop PV generation to electricity load in the CBD area was assessed by comparison to the annual energy consumption seen at the zone substations located in or adjacent to the CBD area for which rooftop PV was modelled. These substations and loads are listed in Table 5, and mapped in Figure 16. The total annual demand for these substations is 2,190 GWh. It must be noted that due to lack of information about which customers are connected to different feeders in the distribution network, and the radial configuration of the network, which is dynamically switched at different times to serve different customers via different substations, it is not possible to accurately estimate the load in the CBD. Nevertheless, this figure can be used to give a sense of the scale of PV contribution to load in the Brisbane CBD area.

Table 5: Load Data from Energex's Brisbane Zone Substations 2014-2015

Zone Substation		Demand (MWh)	PV Capacity (MVA)
McLachlan St_EGX_20142015	MLS	236,771	1
Victoria Park_EGX_20142015	VPK	134,988	0
Astor Terrace_EGX_20142015	ATC	106,997	0
Ann St_EGX_20142015	AST	176,396	17
Charlotte St_EGX_20142015	CST	386,179	2
Makerston St	MST	284,482	8.9
Newstead_EGX_20142015	NSD	143,965	0
West End_EGX_20142015	WED	266,425	0
Wellington Rd_EGX_20142015	WRD	249,797	28.7
Milton_EGX_20142015	MLT	204,161	2.2
		2,190,161	59.8

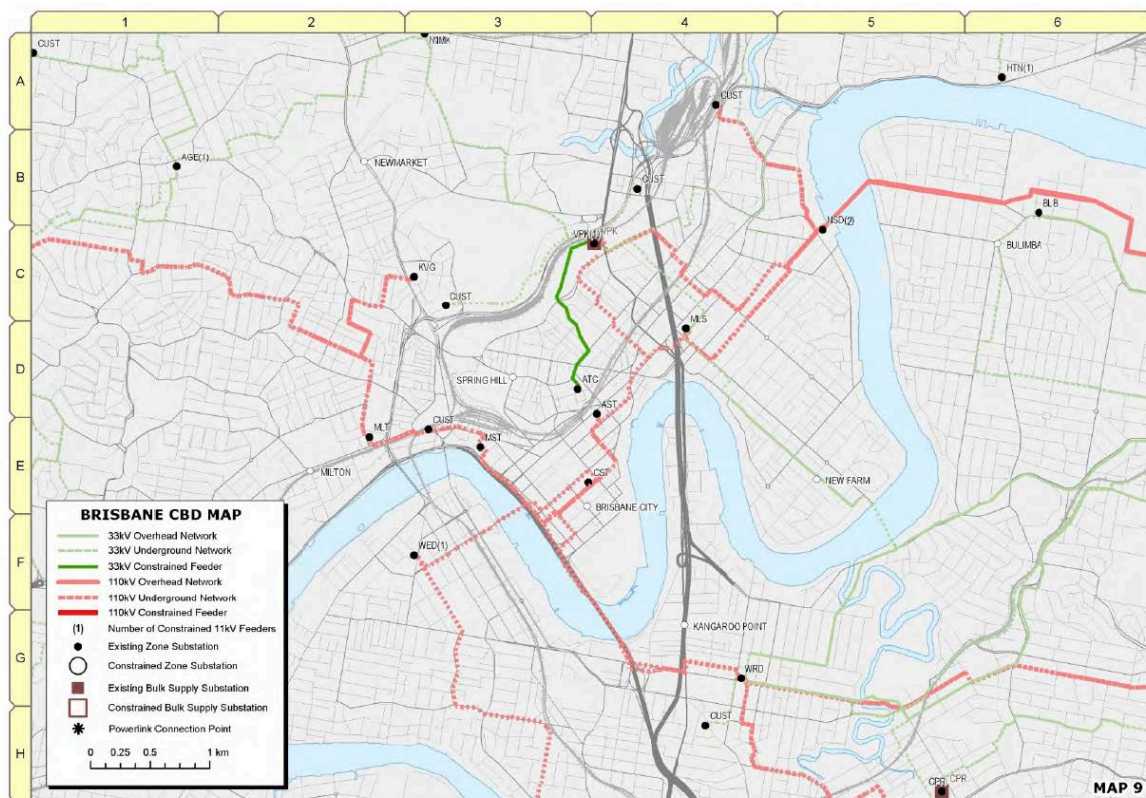


Figure 16: Energex CBD Zone Substations

In order to assess the potential for additional rooftop PV in the Brisbane CBD, and associated emissions reductions and electricity savings, existing PV capacity in the area was estimated. The CBD area covered by this assessment falls predominantly within the postcode 4000, but also includes some buildings in the postcodes 4006, 4101, 4064, 4169, 4005 and 4066. Using the Clean Energy Regulator's database of PV systems registered under the Renewable Energy Target scheme, which is a near complete record of PV systems installed in Australia, the installed PV capacity in these postcodes is listed in Table 6. It was assumed that 100% of the PV systems in 4000, and 5% of the PV systems in all the other postcodes in Table 5 are installed on buildings within the CBD study area. The total existing PV capacity is therefore estimated to be around 1.1 MW.

Table 6: Existing PV Capacity in Brisbane CBD Postcodes

Postcode	PV Capacity (MW)
4000	0.66
4005	1.33
4006	1.14
4064	1.84
4066	2.24
4101	2.65

Finally, the annual CO₂-equivalent emission reductions are calculated by multiplying the estimated annual yield by an appropriate emissions factor for Queensland as sourced from the [2016 National](#)

[Greenhouse Account Factors](#). The relevant value for Queensland was **0.79 kg CO₂-e/kWh** which is **reduced by 0.045 kg CO₂-e/kWh to account for the embodied carbon emissions from the manufacture, installation, operation and decommissioning of the PV systems**. The value of 45 g CO₂-e/kWh of electricity produced was sourced from the PV LCA Harmonization Project results found in [5], which standardised the results from 13 life cycle assessment studies of PV systems with crystalline PV modules, assuming system lifetimes of 30 years.

Results

Table 7 presents a summary of the results of the rooftop suitability assessment for the Brisbane CBD. Results are presented for the average and standard deviation (Std) of the sensitivity analysis undertaken by assessing the two input data sources and the two calculation methodologies. A comprehensive breakdown of the results by method and input data source are presented in Appendix B.

The conservative estimate suggests the useable area suitable for rooftop PV deployment (the ratio between the area of PV panels that could be accommodated and the total roof area) is 36% corresponding to 151 MW of PV potential with an expected annual yield of 197 GWh. The equivalent CO₂ emission savings are 145 kt per year. These values were calculated using the LiDAR data as the input data source in conjunction with NREL's hillshade and orientation method.

The average of the two methods indicated that an area equal to 45% of the available roof surfaces could be used to accommodate PV, corresponding to 188 MW of PV potential with an expected annual yield of 241 GWh, with corresponding potential CO₂-equivalent emission savings of 177 kt per year.


Table 7: Summary of results categorised by the Brisbane City Plan 2014 zoning layer

Brisbane City Council Zoning	Percentage Useable Area		Capacity (MW)		Yield (GWh)	
	Average	Std	Average	Std	Average	Std
All	45.22%	8.72%	187.86	43.00	241.06	36.23
Centre	36.43%	7.83%	52.29	12.55	64.89	11.25
Community facilities	52.44%	8.67%	3.65	0.64	4.64	0.60
Emerging communities	56.69%	11.21%	3.24	0.74	4.22	0.64
General residential	41.67%	9.01%	42.32	11.54	54.98	9.15
Mixed use	54.78%	10.05%	62.25	13.75	80.94	11.42
Planning scheme	54.44%	8.99%	18.37	3.74	23.92	3.03
Recreation and open space	35.10%	4.97%	0.79	0.12	1.00	0.11
Special purpose	22.00%	11.91%	0.18	0.09	0.21	0.10
Specialised centre	69.19%	10.63%	3.77	0.60	4.90	0.58
Sport and recreation	35.46%	5.93%	0.63	0.14	0.84	0.11

The average estimate of PV generation (241 GWh) equates to around 11% of the 2,190 GWh of load seen by all of the zone substations within or near the CBD area. Note that this is a likely overestimate of the CBD load, since these substations also serve loads outside of the CBD area. There is an estimated 1.12 MW of existing PV capacity installed on Brisbane CBD rooftops, less than

1% of the potential capacity. The electricity generation and emissions savings calculated would therefore be almost all additional.

The rooftops with the largest PV potential in Brisbane have been mapped (Figure 1 below). More detailed images appear within the report.

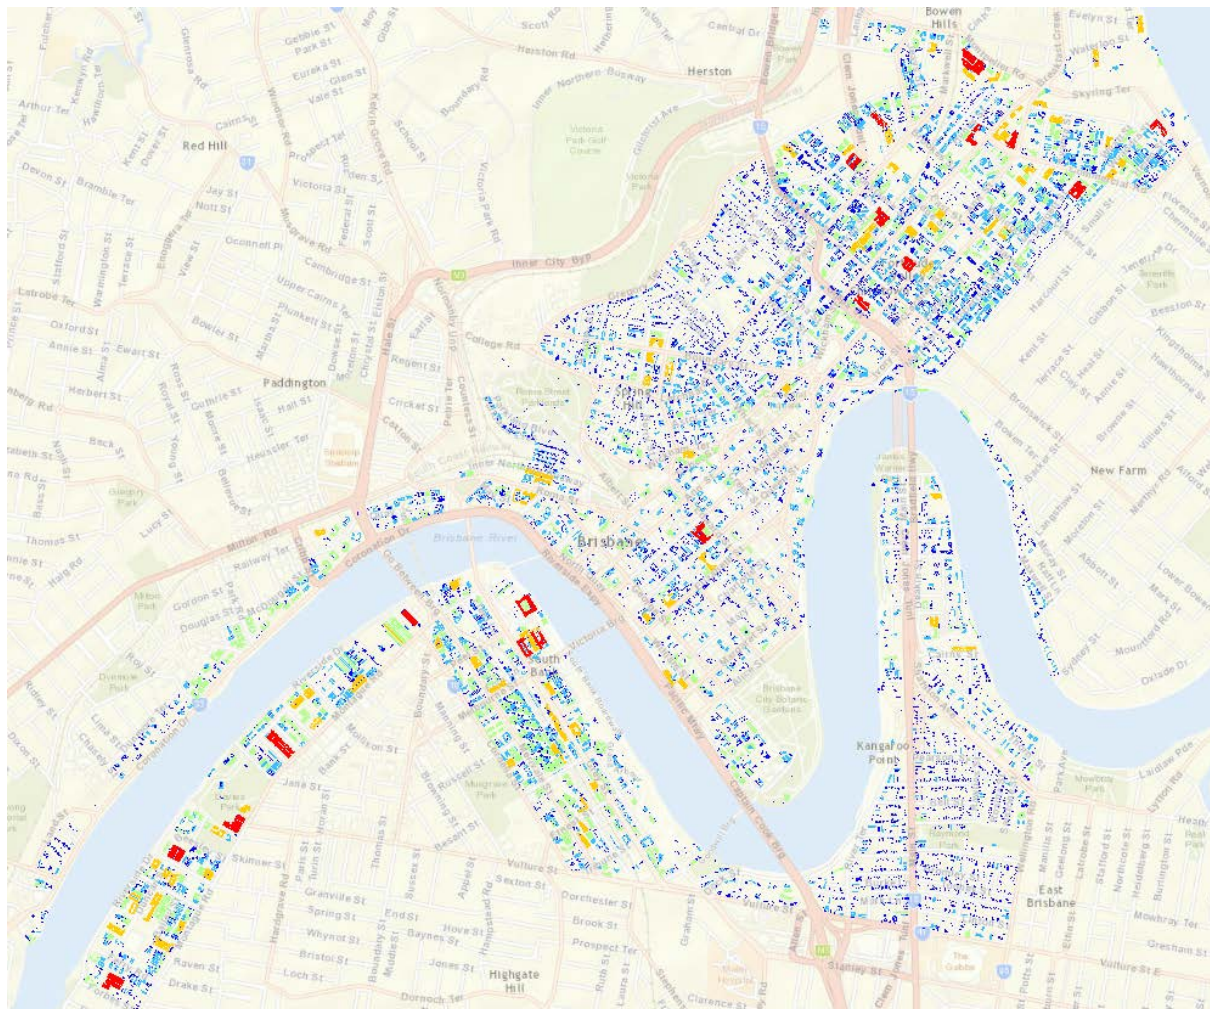

large - med - small

Figure 17: Rooftops with Largest PV Potential in Brisbane CBD

Case Studies of Landmark Buildings

This section of the report details the methodology and the results for a detailed assessment of the PV potential for 3 landmark Brisbane buildings, Queensland Performing Arts Centre (QPAC), the Suncorp Stadium and Roma Street Station.

Methodology

The case studies were assessed by combining the GIS analysis used to assess the PV potential of Brisbane CBD with a visual assessment of the building roof profiles using aerial imagery.

Assessment of Roof Area

Firstly, Method 1 above was used to identify developable roof planes: continuous areas greater than 10m² receiving 80% of the annual insolation for an unshaded horizontal surface (4 kWh/m²/day).

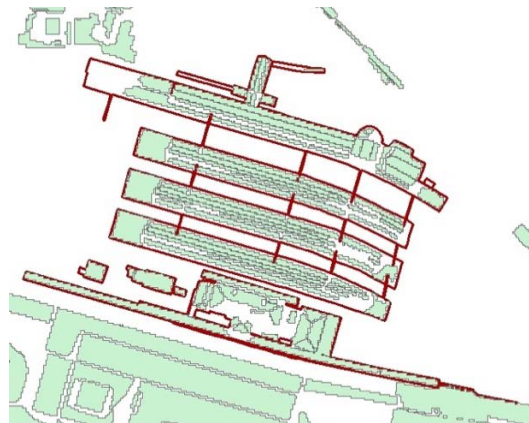


Figure 18: Developable Planes with > 4KWh/m²/day

The roof surfaces were then assessed visually, using imagery from multiple sources: aerial plan view images from *Nearmap* and *Google Earth*, multiple viewpoint aerial imagery from *Nearmap*, and photographs sourced from the internet. Unsuitable surfaces, including staircases, temporary structures, and public spaces (roof terraces, platforms, etc.), were identified and excluded from the usable roof area.

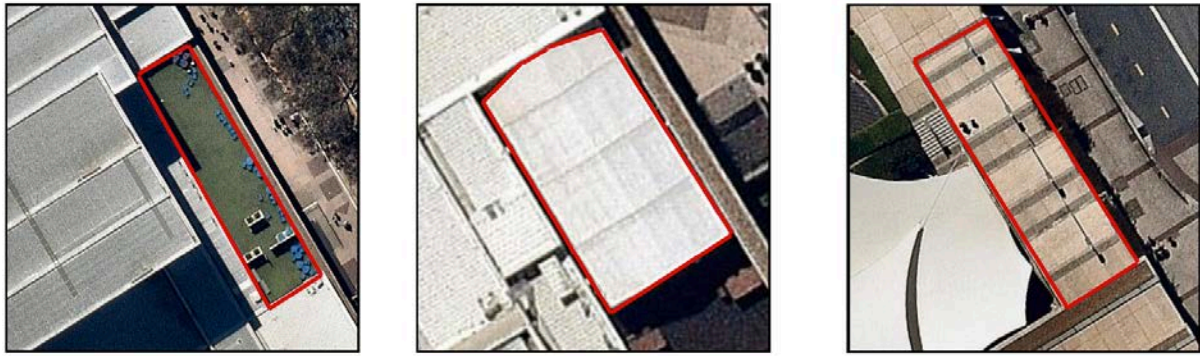


Figure 19: Examples of unsuitable surfaces (a) rooftop terrace, (b) temporary structure, (c) staircase

Small rooftop obstructions and perimeter walls below the resolution of the GIS data were also identified and their height was estimated using multiple viewpoint aerial imagery. (see Figure 20)



Figure 20: Estimation of rooftop obstructions

The shading on a PV module at a range of distances from obstructions of different heights was modelled using the 3D shading calculator in NREL's System Advisor Model (SAM) and the impact on annual output for a horizontal PV panel in Brisbane (using the Brisbane RMY weather file from Energy Plus[6]) was calculated. Figure 21 shows the results for a small range of distances and wall heights. Using this data, additional roof area proximate to rooftop obstructions was excluded if estimated annual output was less than 80% of an unshaded horizontal panel.

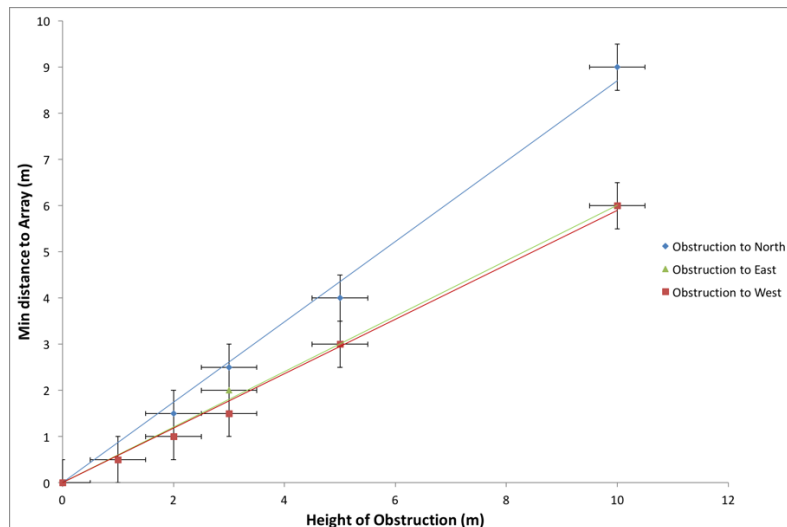


Figure 21: Nearest distance to obstruction to give 80% annual output

Nearmap's Solar Tool was then used to arrange 1.6m x 1.0m PV panels on the usable roofspace, For the 2 buildings (Roma St and QPAC) within the geographical area of the GIS analysis, the slope was determined from the GIS building slope layer. For the Suncorp Stadium, which is situated outside this area, the slope was estimated as 5° using a *Google Earth* 3D building model. For sloping roofs, the panels were positioned flush with the roof in order to avoid self-shading and maximise generation. For flat roofs, panels were orientated towards North (i.e. between 045° and 315°) at a tilt angle of 5°.

As the assessment was carried out remotely, there may be additional physical constraints on the available roof area as well as structural restrictions on the potential array size that have not been considered here.

Calculation of PV Capacity and Annual Yield

The power capacity of the array was calculated using a nominal output of 250W per module (equivalent to a DC size factor of 156.25 W/m²), and an initial value for the predicted annual energy output (without accounting for shading losses) was calculated for each orientation and tilt using SAM's PVWatts model and a derate factor of 0.77.

To account for shading losses, the average yield (in kWh/kW/day) was calculated using the APVI SPT method, averaged across all developable roof planes within the building footprint. This yield was then applied to the calculated array size to give a predicted annual generation accounting for shading losses. As it is outside the area of the APVI solar potential map, shading losses for Suncorp stadium were modelled using SAM's 3D Shading Model.

Calculation of Emissions Offset

The potential CO₂-e emissions reductions from the modelled PV systems on the 3 landmark buildings were calculated by multiplying the indirect (Scope 2) emissions factor for consumption of electricity purchased from the grid in Queensland (0.78 kg CO₂-e/kWh[7]) by the expected annual energy generation from the system, and subtracting the estimated embodied carbon emissions from the manufacture, installation, operation and decommissioning of the PV system (0.045kg CO₂-e /kW[5])

Results

Table 8 shows the potential roof area available for PV installation on each building, based on the data and visual imagery available. Despite their irregular roof profiles, both QPAC and Roma Street Station show potential for utilisation of just under half of the total roof area, comparing favourably with the average across the CBD. The simple roof profile and lack of shading give the Suncorp Stadium very high potential utilisation.

Table 8: Available roof areas

Site	Building Footprint (m ²)	Total Roof Area (m ²)	Developable Planes (m ²)	Array Area (m ²)	Array Area / Roof Area
Suncorp Stadium	41,426	24,200	not available	21,302	88%
Roma St Station	14,359	11,503	6,357	5,525	48%
QPAC	11,791	11,791	8,543	5,760	49%

Table 9 shows the projected array capacity and expected annual energy production. The proposed PV arrays are illustrated in Figure 22 -Figure 24 below.

Table 9: Expected Annual Energy Production

Site	Array Power (kW)	Annual Energy Production (w/o shading) (MWh/year)	Average Yield across developable planes (kWh/kW/day)	Expected Annual Energy Production (MWh/year)
Suncorp	3328.5	4684	3.84	4670
Roma St	863.3	1196	3.61	1136
QPAC	900.0	1300	3.57	1172

Table 10 presents the estimated carbon offsets for each system and shows that these three buildings could save an estimated 5.2 kilotonnes of carbon emissions each year and could supply the equivalent of 1200 households, based on the average 2014 electricity demand of a Queensland household being 5793 kWh [8].

Table 10: Carbon offset and household energy equivalents

Site	Expected Annual Energy Production (MWh/year)	Emissions Offset (Tonnes CO ₂ -e / year)	Average household equivalent
Suncorp	4670	3493	806
Roma St	1136	847	196
QPAC	1172	874	202
Totals	6978	5214	1205

Array Illustrations



Figure 22: Potential PV Array on Suncorp Stadium



Figure 23: Potential PV Array on QPAC

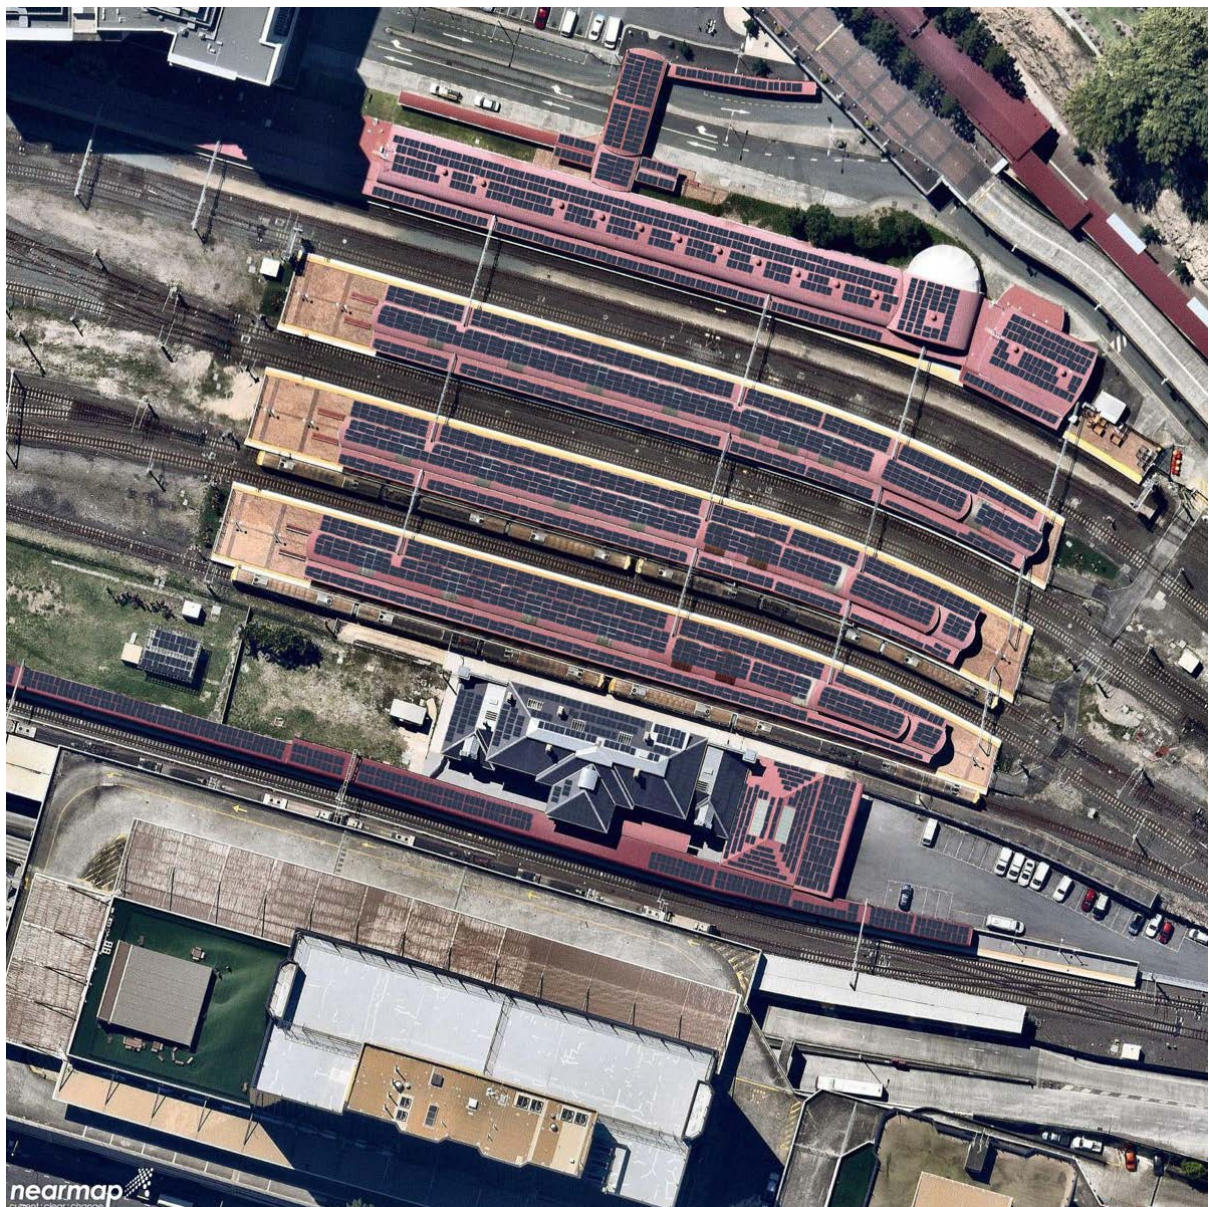


Figure 24: Potential PV Array at Roma Street Station

References

1. Copper, J.K. and A.G. Bruce. *APVI Solar Potential Tool - Data and Calculations*. 2014; Available from: http://d284f79vx7w9nf.cloudfront.net/assets/solar_potential_tool_data_and_calcs-2dc0ced2b70de268a29d5e90a63432d7.pdf.
2. Copper, J.K. and A.G. Bruce. *Validation of Methods Used in the APVI Solar Potential Tool*. 2014; Available from: http://apvi.org.au/solar-research-conference/wp-content/uploads/2015/04/1-Copper_APVI_PVSystems_PeerReviewed.pdf.
3. Gagnon, P., et al. *Rooftop Solar Photovoltaic Technical Potential in the United States: A Detailed Assessment*. NREL/TP-6A20-65298 2016; Available from: <http://www.nrel.gov/docs/fy16osti/65298.pdf>.
4. Copper, J.K., A.B. Sproul, and A.G. Bruce, *A method to calculate array spacing and potential system size of photovoltaic arrays in the urban environment using vector analysis*. *Applied Energy*, 2016. **161**: p. 11-23.
5. Hsu, D.D., et al., *Life Cycle Greenhouse Gas Emissions of Crystalline Silicon Photovoltaic Electricity Generation*. *Journal of Industrial Ecology*, 2012. **16**: p. S122-S135.
6. *Energy Plus Weather Data - Southwest Pacific Region*. Available from: https://energyplus.net/weather-region/southwest_pacific_wmo_region_5/AUS.
7. Department of Environment and Energy, *National Greenhouse Accounts Factors*. 2016.
8. Acil Allen Consulting, *Electricity Benchmarks final report v2 - Revised March 2015*. 2015, Australian Energy Regulator.

Appendix A – Comparison between APVI SPT Simple PV Performance Method vs. Detail Hourly Simulation of PV Performance in NREL’s System Advisor Model

Figure 25 presents a comparison between the calculated annual yields using APVI SPT simplified method versus detailed hourly simulations of PV performance using NREL’s SAM PVWatts module with default settings. The results highlight the similarity in the calculated values, and demonstrate how the annual yield can be calculated using a simplified methodology, which requires as input only the annual or monthly averages of surface insolation in kWh/m²/day. The simplified APVI SPT methodology enables geospatial calculation of yield for each identified roof surface.

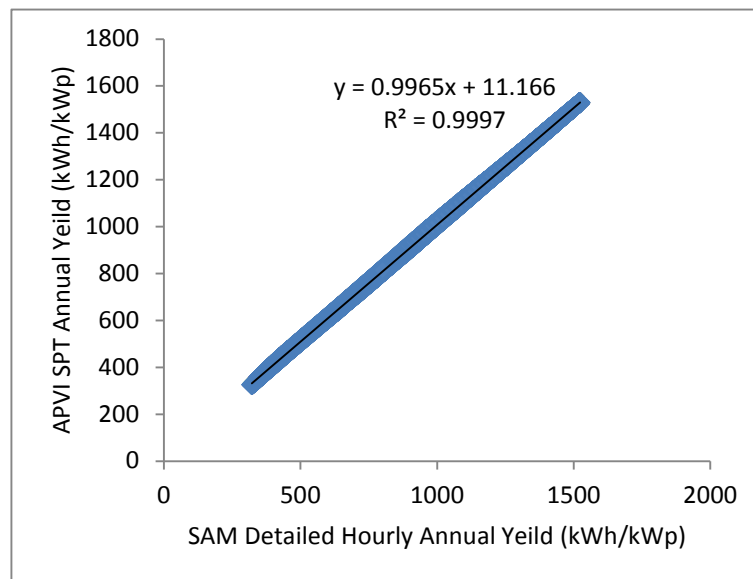


Figure 25: Correlation between APVI SPT simplified method to calculate annual yield from annual average insolation vs. detailed hourly simulations of PV performance from NREL’s SAM. Results presented for each 1 degree combination of tilt (0-90°) and orientation (0-360°).

Appendix B – Assessment of Rooftop Suitability – Detailed Results


Table 11: Detailed results of rooftop suitability calculated using AAM DSM and 3D buildings


Brisbane City Council Zoning	Total Area (ha)	Method 1 - Insolation Limit (4kWh/m2/day) - 3D Buildings				Method 2: NREL Hillshade E/NE/N/NW/W (19.13) - 3D Buildings			
		Developable (ha)	% Useable	Capacity (MW)	Yield (GWh)	Developable (ha)	% Useable	Capacity (MW)	Yield (GWh)
All	265.89	142.27	53.51%	222.29	283.67	137.94	51.88%	215.53	271.64
Centre	91.86	39.12	42.59%	61.13	75.45	40.23	43.80%	62.86	75.96
Community facilities	4.45	2.71	60.73%	4.23	5.25	2.63	59.02%	4.11	5.13
Emerging communities	3.66	2.54	69.40%	3.97	5.08	2.26	61.73%	3.53	4.51
General residential	65.00	33.41	51.40%	52.20	67.56	30.61	47.10%	47.83	61.72
Mixed use	72.72	46.92	64.51%	73.31	94.83	45.28	62.26%	70.75	90.44
Planning scheme	21.59	13.66	63.28%	21.35	27.72	13.10	60.65%	20.46	26.32
Recreation and open space	1.44	0.58	40.50%	0.91	1.12	0.44	30.74%	0.69	0.88
Special purpose	0.53	0.17	32.32%	0.27	0.29	0.17	32.24%	0.27	0.29
Specialised centre	3.49	2.67	76.57%	4.18	5.35	2.79	79.93%	4.36	5.49
Sport and recreation	1.15	0.49	42.52%	0.76	1.01	0.43	37.53%	0.67	0.89

Table 12: Detailed results of rooftop suitability calculated using Queensland Brisbane City Council 2009 LiDAR dataset from Geoscience Australia

Brisbane City Council Zoning	Method 1 - Insolation Limit (4kWh/m2/day) - LiDAR				Method 2: NREL Hillshade E/NE/N/NW/W (19.13) - LiDAR			
	Developable (ha)	% Useable	Capacity (MW)	Yield (GWh)	Developable (ha)	% Useable	Capacity (MW)	Yield (kWh)
All	103.79	39.03%	162.17	212.19	96.92	36.45%	151.44	196.76
Centre	27.78	30.24%	43.40	55.58	26.74	29.11%	41.78	52.56
Community facilities	2.06	46.17%	3.21	4.20	1.95	43.84%	3.05	4.00
Emerging communities	1.90	51.86%	2.96	3.95	1.60	43.76%	2.50	3.35
General residential	23.16	35.63%	36.19	47.43	21.16	32.56%	33.07	43.20
Mixed use	34.63	47.62%	54.11	71.59	32.53	44.73%	50.83	66.91
Planning scheme	10.67	49.42%	16.67	21.93	9.59	44.40%	14.98	19.70
Recreation and open space	0.55	38.13%	0.86	1.09	0.45	31.02%	0.70	0.91
Special purpose	0.07	12.81%	0.11	0.14	0.06	10.61%	0.09	0.12
Specialised centre	2.16	61.77%	3.37	4.49	2.04	58.50%	3.19	4.28
Sport and recreation	0.38	33.07%	0.59	0.78	0.33	28.72%	0.51	0.68

Appendix C – Detailed Maps of Rooftops with Large Solar Potential

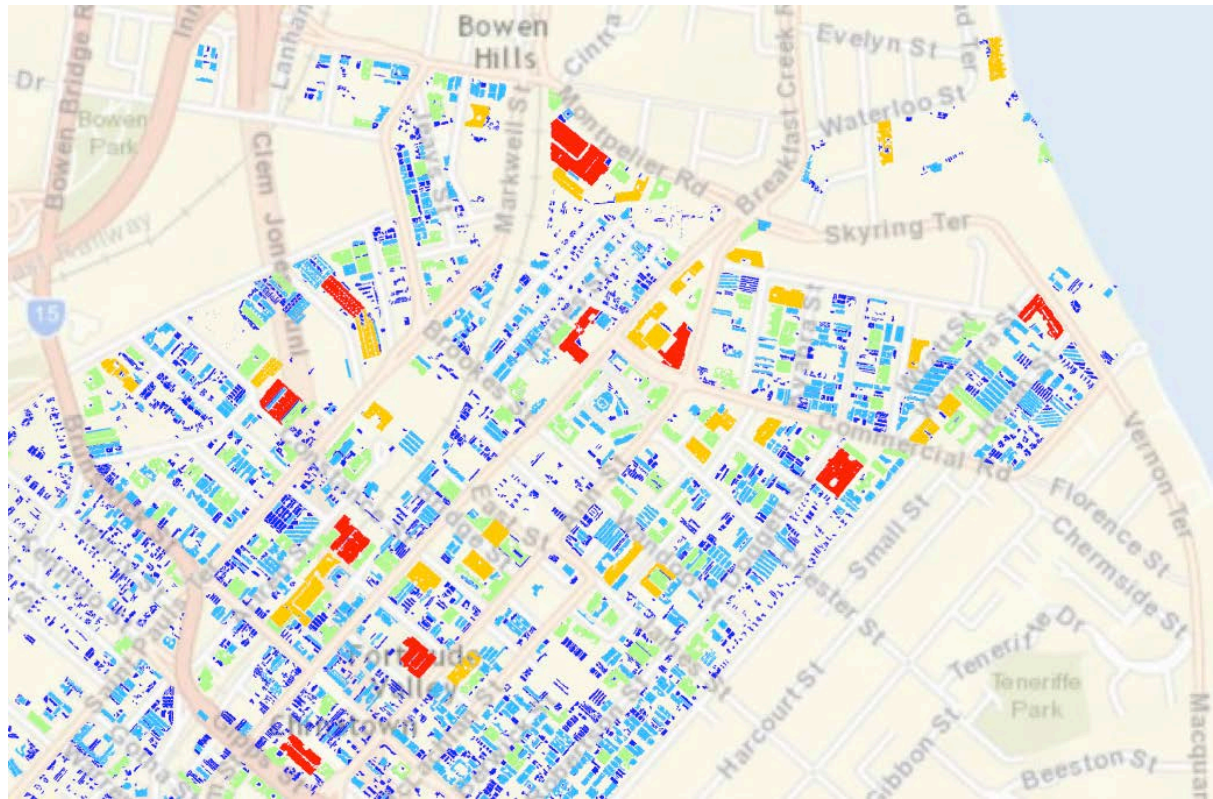

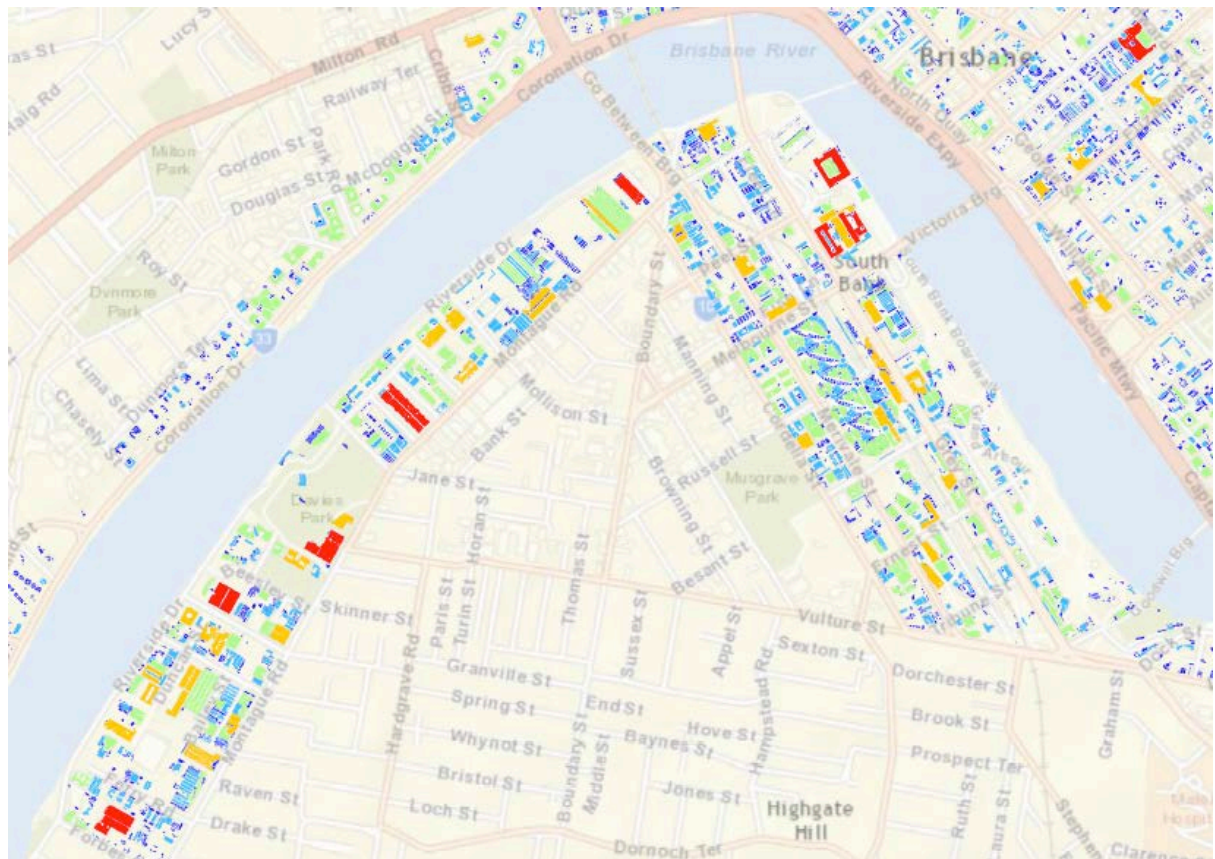

high - med - low